


1 SURFACE MOUNTED COUNTERFLASHING

C04 NOT TO SCALE

NOTES:

1. THIS DETAIL SHOULD BE USED ONLY WHERE THE DECK IS SUPPORTED BY THE WALL.
2. REFER TO THE SHEET METAL SECTION OF THE METAL ROOFING MANUAL FOR JOINERY AND SECUREMENT OPTIONS FOR SHEET METAL.

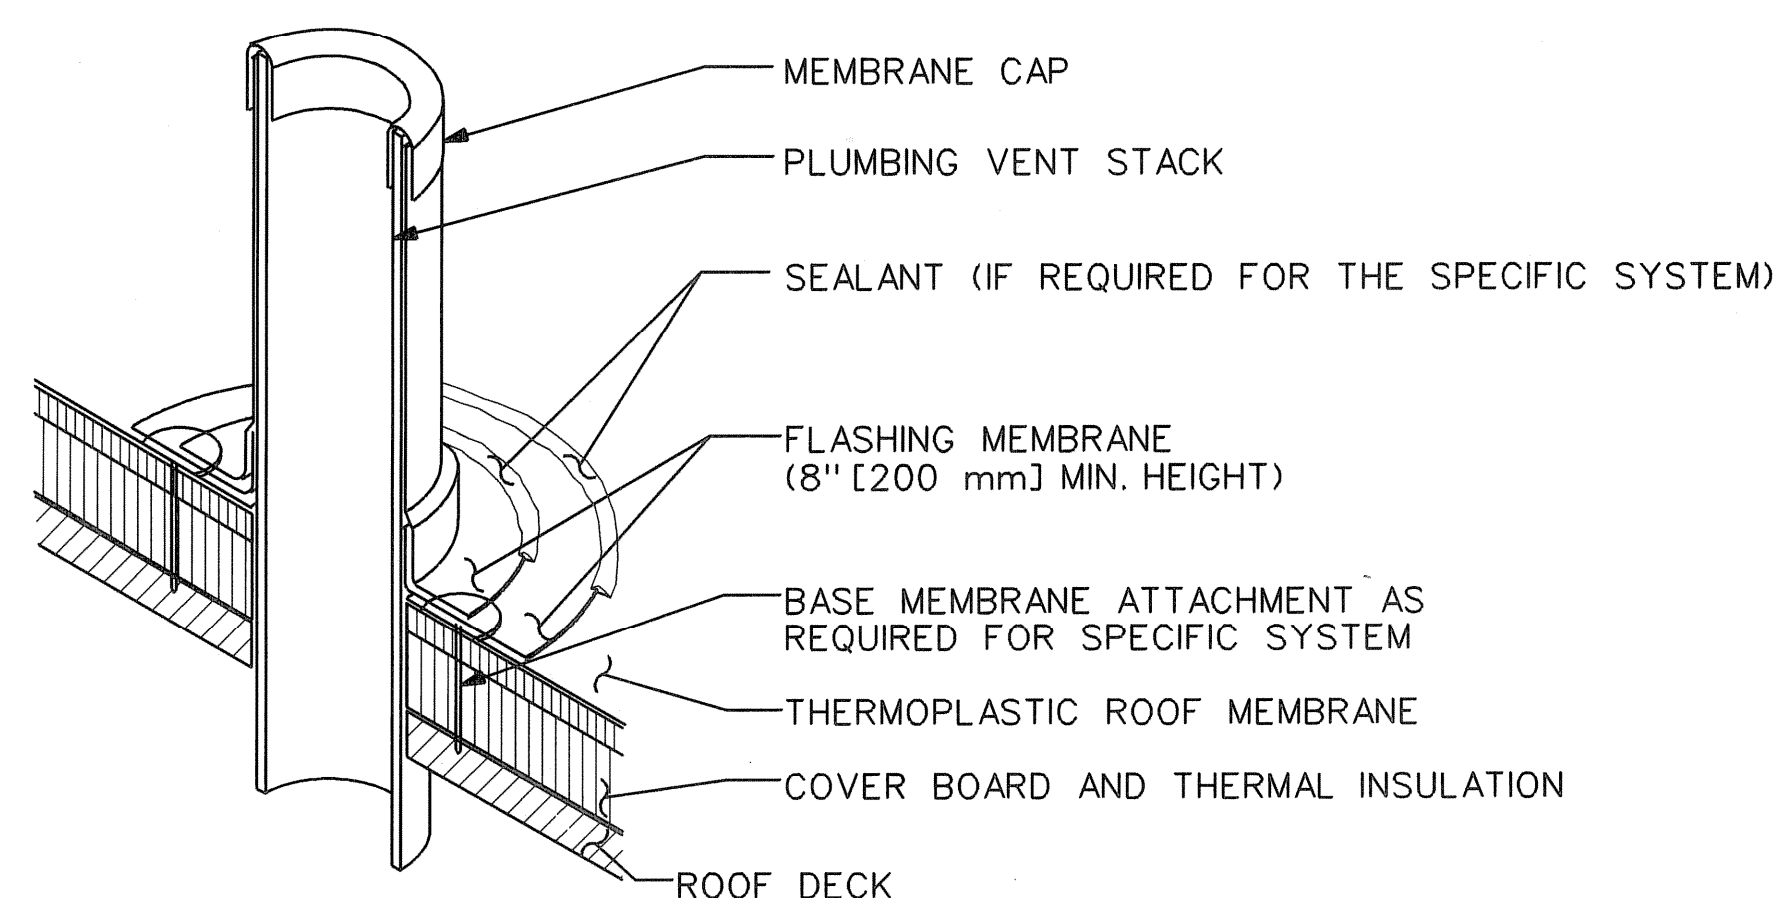


3 PLUMBING VENT ROOF DETAIL

C04 NOT TO SCALE

NOTE:

1. VENT STACKS AND OTHER PIPES SHOULD HAVE A MINIMUM OF 12 INCHES [300 mm] OF CLEARANCE ON ALL SIDES FROM WALLS, CURBS, AND OTHER PROJECTIONS TO FACILITATE PROPER FLASHING.

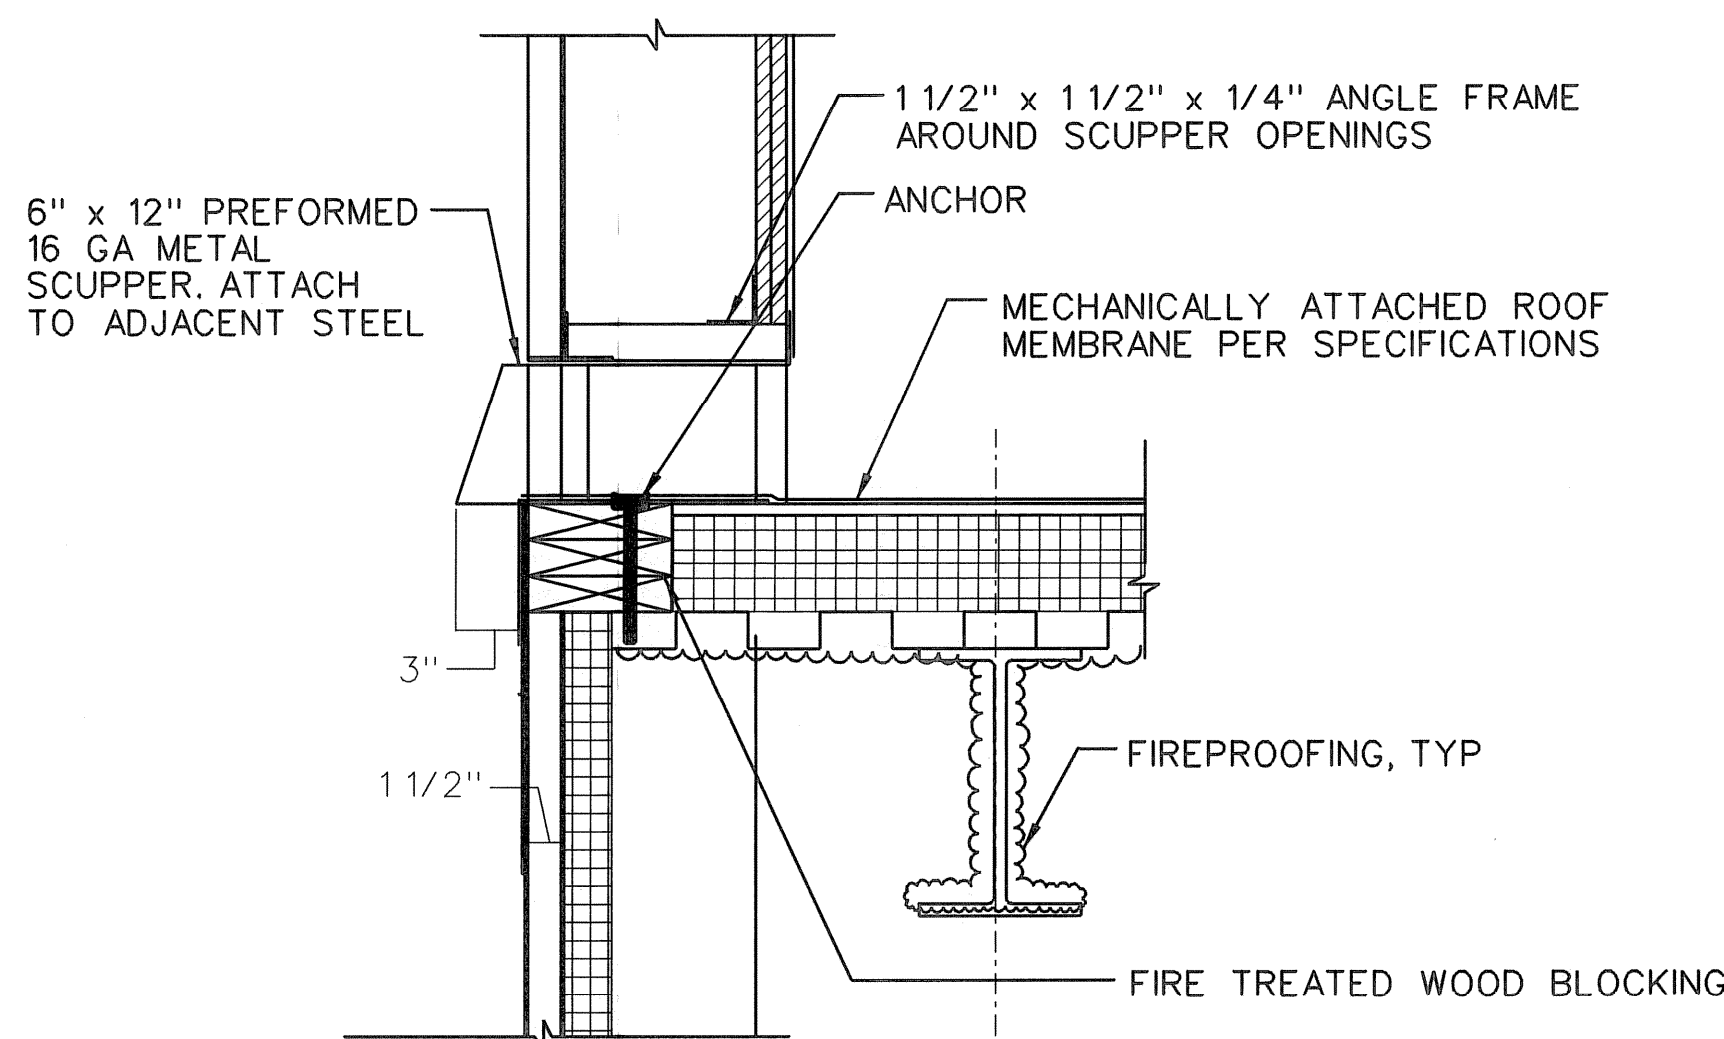


2 SCUPPER DETAIL

C04 NOT TO SCALE

NOTE:

1. SEE DETAIL 1/C03 FOR ACTUAL ROOF ASSEMBLY.

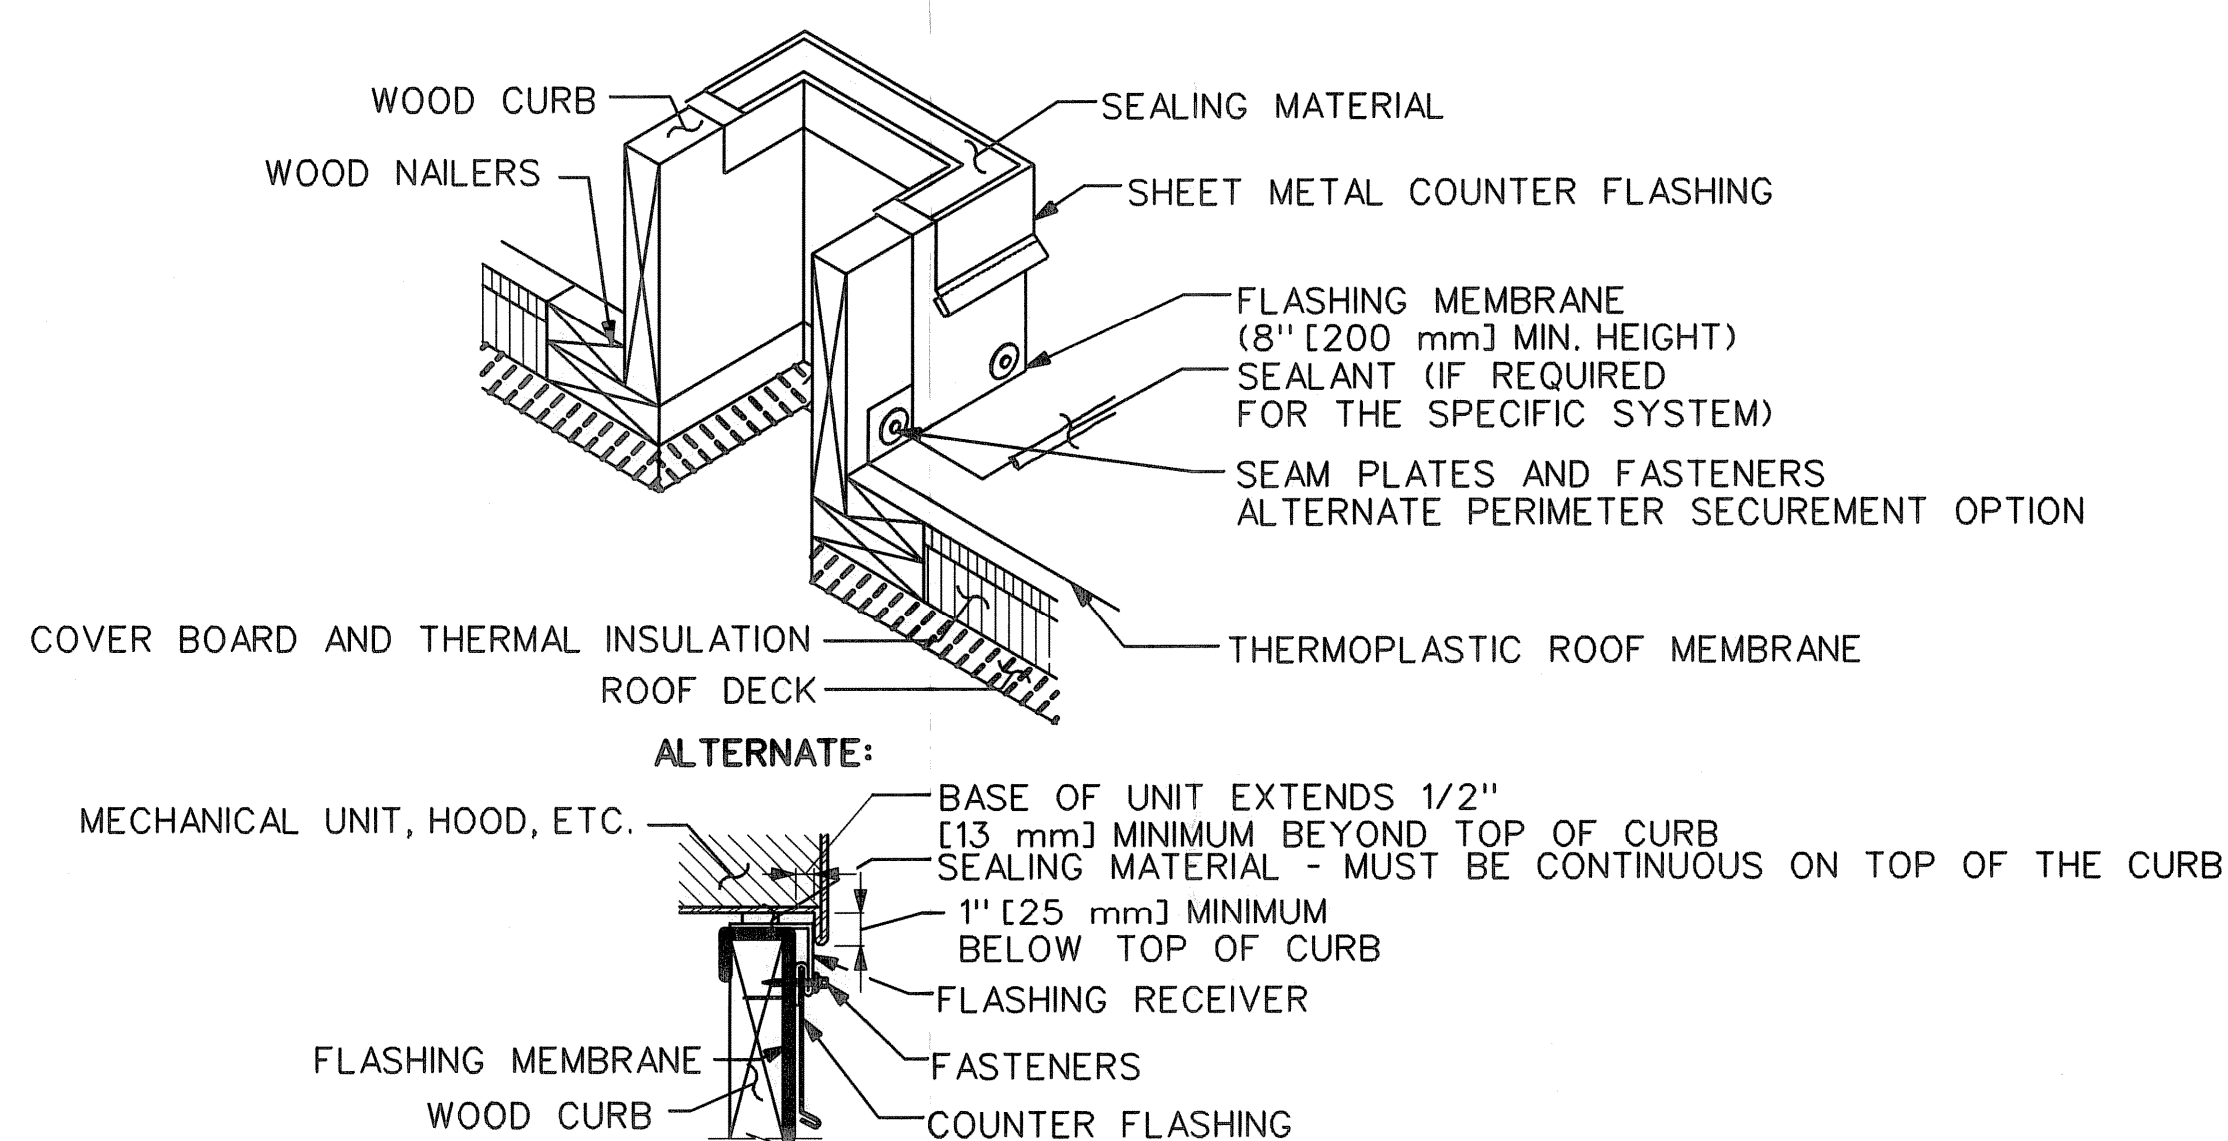

4 EQUIPMENT CURB ROOF DETAIL

C04 NOT TO SCALE

NOTES:

1. THE MECHANICAL UNITS SHOULD NOT BE SET UNTIL THE ROOF MEMBRANE AND FLASHING HAVE BEEN INSTALLED.
2. REFER TO THE SHEET METAL SECTION OF THE METAL ROOFING MANUAL FOR JOINERY AND SECUREMENT OPTIONS FOR SHEET METAL.

A 06/21/2007 ENGINEERING REVISIONS RWK 622128 06/19/2007

REV	DATE	DESCRIPTION	JCN	REDLINE DATE	APVD

DEPARTMENT OF TRANSPORTATION
FEDERAL AVIATION ADMINISTRATION
ATLANTA IMPLEMENTATION CENTER ATLANTA, GA

ARTCC
ROOF REPLACEMENT
ROOF DETAILS

MEMPHIS	MEMPHIS CENTER	
REVIEWED BY	SUBMITTED BY	APPROVED BY
DESIGNED	ISSUED BY	DATE
		06/19/2007
DRAWN	NAS IMPLEMENTATION	DRAWING NO
	ANI-300	622128
CHECKED		REV

ZME-D-622128-C04